



Report No: FYSH14S-02324-1
Issue No: 1

Material Test Report


Client: G C Schmidt Pty Ltd
 12 Bass Street
 Queanbeyan NSW 2620

Principal:

Project No.: INFOFYSH00340AA
Project Name: NERRIGA QUARRY
Lot No.: Sealing Agg SP 3 **TRN:** 227

Accredited for compliance with ISO/IEC 17025.

The results of the tests, calibrations and/or measurements included in this document are traceable to Australian/national standards.



WORLD RECOGNISED ACCREDITATION

Approved Signatory: Jan Penon
 (Principal Technician)
 NATA Accredited Laboratory Number: 431
 Date of Issue: 26/11/2014

Sample Details

Sample ID: FYSH14S-02324
Client Sample:
Date Sampled: 25/11/2014
Source: Nerriga Quarry
Material: Sealing Aggregate
Specification: 7mm Sealing Aggregate - RTA 3151(ED10)
Sampling Method: Submitted by client
Project Location: BRAIDWOOD, NSW
Sample Location: Nerriga Quarry
 7mm Aggregate
 Stockpile 3


Particle Size Distribution

Method: RMS T201
Drying by: Oven
Date Tested: 26/11/2014

Sieve Size	% Passing	Limits
9.5mm	100	100
6.7mm	86	90 to 100
4.75mm	25	0 to 35
2.36mm	4	0 to 10
1.18mm	2	0 to 2
75µm	1.0	
Finer 75µm	0.4	

Other Test Results

Description	Method	Result	Limits
Average Least Dimension (mm)	RMS T235		≥3.5
Average Least Dimension (mm)	RMS T275	3.7	≥3.5

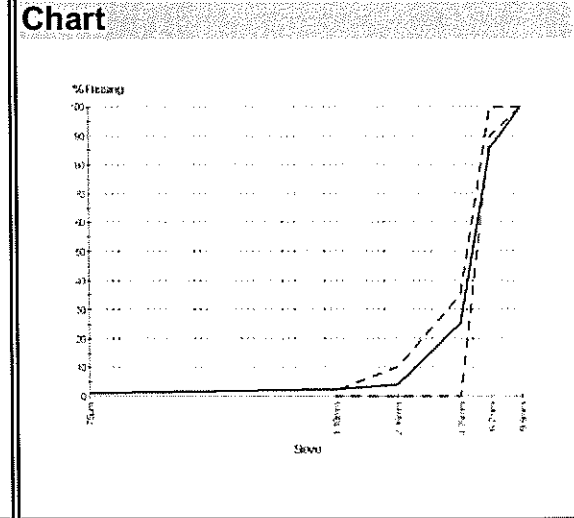

Comments

N/A